



水務署
Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4367

圖文傳真
Facsimile 2824 0578

檔號
Reference (2) in WSD 3321/15 Pt.1 T/J(785)

21 January 2016

Approval of "SIAMP" Float Operated Valve

Your letter ref. HW/15036/KL/eh dated 31 December 2015 refers.

Having considered test report ref. J19150 issued on 23 December 2015 by the Nutek Systems, Ltd., this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: SIAMP Ltd.

Country of Origin: Monaco

Brand: SIAMP

Details of Fittings: 1/2" Plastic float operated valve for WC cistern; for sea / salt water application

Model: 93B & 93T

Body Markings: Nil

Expiry Date: 17 December 2020

Proviso: As the fittings have not been tested for use in contact with water intended for human consumption, the fittings can only be used in flushing water plumbing system.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

“The flushing volume of the flushing valves should be adjusted to suit the design of the toilet bowl so that wastes can be cleared effectively by a single flush.”

“The maximum flushing cistern volume including that of dual flush cisterns for use in conjunction with the fittings shall not exceed 7.5 litres per flush.”

“The fittings should be used within the range of working pressures specified by the manufacturer.” AND

“The installed fittings should not result in backflow of water that will contaminate the flushing water supply.”

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Ms. K L FOK at tel. no. 2829 5657.

Yours faithfully,



(LAM Ching Man)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
E/CS(TS)1]

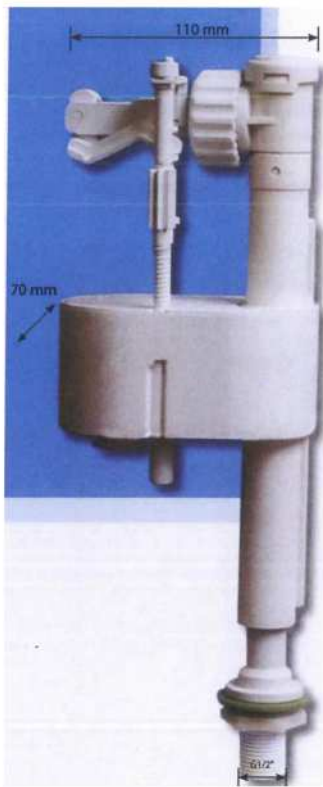

93B

